


NOTES:

1. TO BE FORMED WITH 2" x 6" BOARDS OR STEEL FORMS.
2. TOOLED JOINTS SHALL BE 1/2".
3. EXPANSION JOINTS SHALL BE 3/4" BITUMINOUS IMPREGNATED FIBERBOARD, AT DRIVEWAYS AND OTHER CONCRETE JOINTS.
4. PROVIDE BROOM FINISH.
5. D = 5" MINIMUM THICKNESS FOR ALL RESIDENTIAL WALKS & PATIOS
6. ALL SERVICE WALKS AND PATIOS SHALL BE BUILT PER THE VILLAGE OF WHEELING STANDARDS.
7. THE CONCRETE SHALL BE A 6 BAG MIX (4000 psi) AND SHALL **NOT** CONTAIN CHLORIDE.

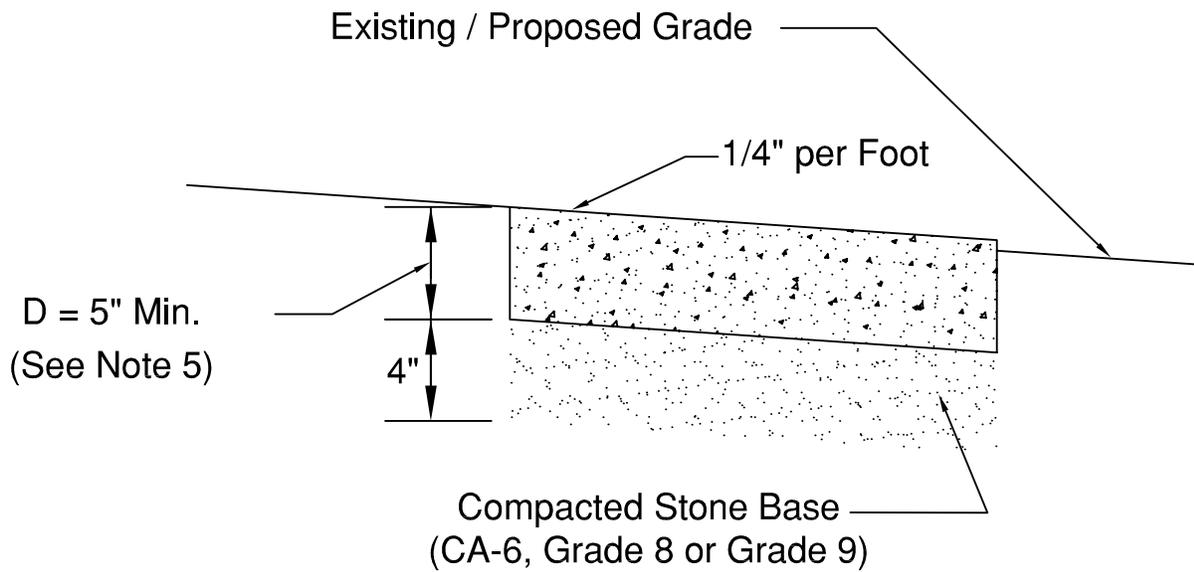

SERVICE WALKS AND PATIOS

VILLAGE OF WHEELING / ENGINEERING DEPT.

SERVICE WALKS AND PATIOS

REVISIONS

W.F.H.	10/04/04 AUTOCAD FILE
S.W.	03/23/05 COMMENTS BY GK
K.R.G.	9/11/06 AUTOCAD FILE
S.W.	04/25/07 REVISED PER COMMENTS